

Air Quality Monitoring Data

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2020-03-04	AMS5	13:03	1-hr TSP	31	µg/m ³
HKLR	HY/2011/03	2020-03-04	AMS5	14:03	1-hr TSP	40	µg/m ³
HKLR	HY/2011/03	2020-03-04	AMS5	15:03	1-hr TSP	67	µg/m ³
HKLR	HY/2011/03	2020-03-10	AMS5	09:01	1-hr TSP	8	µg/m ³
HKLR	HY/2011/03	2020-03-10	AMS5	10:01	1-hr TSP	8	µg/m ³
HKLR	HY/2011/03	2020-03-10	AMS5	11:01	1-hr TSP	14	µg/m ³
HKLR	HY/2011/03	2020-03-16	AMS5	09:00	1-hr TSP	68	µg/m ³
HKLR	HY/2011/03	2020-03-16	AMS5	10:00	1-hr TSP	57	µg/m ³
HKLR	HY/2011/03	2020-03-16	AMS5	11:00	1-hr TSP	52	µg/m ³
HKLR	HY/2011/03	2020-03-20	AMS5	09:07	1-hr TSP	83	µg/m ³
HKLR	HY/2011/03	2020-03-20	AMS5	10:07	1-hr TSP	76	µg/m ³
HKLR	HY/2011/03	2020-03-20	AMS5	11:07	1-hr TSP	89	µg/m ³
HKLR	HY/2011/03	2020-03-26	AMS5	10:05	1-hr TSP	57	µg/m ³
HKLR	HY/2011/03	2020-03-26	AMS5	11:05	1-hr TSP	71	µg/m ³
HKLR	HY/2011/03	2020-03-26	AMS5	13:05	1-hr TSP	42	µg/m ³
HKLR	HY/2011/03	2020-03-31	AMS5	10:00	1-hr TSP	194	µg/m ³
HKLR	HY/2011/03	2020-03-31	AMS5	11:00	1-hr TSP	192	µg/m ³
HKLR	HY/2011/03	2020-03-31	AMS5	13:00	1-hr TSP	160	µg/m ³
HKLR	HY/2011/03	2020-03-03	AMS5	08:00	24-hr TSP	38	µg/m ³
HKLR	HY/2011/03	2020-03-09	AMS5	08:00	24-hr TSP	35	µg/m ³
HKLR	HY/2011/03	2020-03-13	AMS5	08:00	24-hr TSP	21	µg/m ³
HKLR	HY/2011/03	2020-03-19	AMS5	08:00	24-hr TSP	44	µg/m ³
HKLR	HY/2011/03	2020-03-25	AMS5	08:00	24-hr TSP	54	µg/m ³
HKLR	HY/2011/03	2020-03-30	AMS5	08:00	24-hr TSP	78	µg/m ³
HKLR	HY/2011/03	2020-03-04	AMS6	08:05	1-hr TSP	19	µg/m ³
HKLR	HY/2011/03	2020-03-04	AMS6	09:05	1-hr TSP	10	µg/m ³
HKLR	HY/2011/03	2020-03-04	AMS6	10:05	1-hr TSP	19	µg/m ³
HKLR	HY/2011/03	2020-03-10	AMS6	13:03	1-hr TSP	24	µg/m ³
HKLR	HY/2011/03	2020-03-10	AMS6	14:03	1-hr TSP	27	µg/m ³
HKLR	HY/2011/03	2020-03-10	AMS6	15:03	1-hr TSP	37	µg/m ³
HKLR	HY/2011/03	2020-03-16	AMS6	13:00	1-hr TSP	58	µg/m ³
HKLR	HY/2011/03	2020-03-16	AMS6	14:00	1-hr TSP	54	µg/m ³
HKLR	HY/2011/03	2020-03-16	AMS6	15:00	1-hr TSP	53	µg/m ³
HKLR	HY/2011/03	2020-03-20	AMS6	10:03	1-hr TSP	70	µg/m ³
HKLR	HY/2011/03	2020-03-20	AMS6	11:03	1-hr TSP	65	µg/m ³
HKLR	HY/2011/03	2020-03-20	AMS6	13:03	1-hr TSP	76	µg/m ³
HKLR	HY/2011/03	2020-03-26	AMS6	09:04	1-hr TSP	87	µg/m ³
HKLR	HY/2011/03	2020-03-26	AMS6	10:04	1-hr TSP	75	µg/m ³
HKLR	HY/2011/03	2020-03-26	AMS6	11:04	1-hr TSP	80	µg/m ³
HKLR	HY/2011/03	2020-03-31	AMS6	09:08	1-hr TSP	41	µg/m ³
HKLR	HY/2011/03	2020-03-31	AMS6	10:08	1-hr TSP	15	µg/m ³
HKLR	HY/2011/03	2020-03-31	AMS6	11:08	1-hr TSP	66	µg/m ³
HKLR	HY/2011/03	2020-03-03	AMS6	08:00	24-hr TSP	40	µg/m ³
HKLR	HY/2011/03	2020-03-09	AMS6	08:00	24-hr TSP	30	µg/m ³
HKLR	HY/2011/03	2020-03-13	AMS6	08:00	24-hr TSP	40	µg/m ³
HKLR	HY/2011/03	2020-03-19	AMS6	08:00	24-hr TSP	See Remark 1	µg/m ³
HKLR	HY/2011/03	2020-03-25	AMS6	09:33	24-hr TSP	46	µg/m ³
HKLR	HY/2011/03	2020-03-30	AMS6	08:00	24-hr TSP	81	µg/m ³

Remark:

1) Due to power failure and malfunction of High Volume Sampler (HVS) at AMS6 - Dragonair / CNAC (Group) Building (HKIA), 24-hr TSP monitoring on 19 March 2020 at AMS6 was cancelled. The HVS was repaired on 25 March 2020. The 24-hr TSP monitoring at AMS6 was resumed on 25 March 2020.

Air Quality Monitoring Data

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2020-04-06	AMS5	10:00	1-hr TSP	56	µg/m ³
HKLR	HY/2011/03	2020-04-06	AMS5	11:00	1-hr TSP	98	µg/m ³
HKLR	HY/2011/03	2020-04-06	AMS5	13:00	1-hr TSP	88	µg/m ³
HKLR	HY/2011/03	2020-04-09	AMS5	10:00	1-hr TSP	29	µg/m ³
HKLR	HY/2011/03	2020-04-09	AMS5	11:00	1-hr TSP	29	µg/m ³
HKLR	HY/2011/03	2020-04-09	AMS5	13:00	1-hr TSP	33	µg/m ³
HKLR	HY/2011/03	2020-04-15	AMS5	13:00	1-hr TSP	53	µg/m ³
HKLR	HY/2011/03	2020-04-15	AMS5	14:00	1-hr TSP	46	µg/m ³
HKLR	HY/2011/03	2020-04-15	AMS5	15:00	1-hr TSP	47	µg/m ³
HKLR	HY/2011/03	2020-04-21	AMS5	10:00	1-hr TSP	13	µg/m ³
HKLR	HY/2011/03	2020-04-21	AMS5	11:00	1-hr TSP	10	µg/m ³
HKLR	HY/2011/03	2020-04-21	AMS5	13:00	1-hr TSP	12	µg/m ³
HKLR	HY/2011/03	2020-04-24	AMS5	10:05	1-hr TSP	22	µg/m ³
HKLR	HY/2011/03	2020-04-24	AMS5	11:05	1-hr TSP	26	µg/m ³
HKLR	HY/2011/03	2020-04-24	AMS5	13:00	1-hr TSP	71	µg/m ³
HKLR	HY/2011/03	2020-04-29	AMS5	10:03	1-hr TSP	44	µg/m ³
HKLR	HY/2011/03	2020-04-29	AMS5	11:03	1-hr TSP	38	µg/m ³
HKLR	HY/2011/03	2020-04-29	AMS5	13:03	1-hr TSP	45	µg/m ³
HKLR	HY/2011/03	2020-04-03	AMS5	08:00	24-hr TSP	37	µg/m ³
HKLR	HY/2011/03	2020-04-08	AMS5	08:00	24-hr TSP	38	µg/m ³
HKLR	HY/2011/03	2020-04-14	AMS5	08:00	24-hr TSP	61	µg/m ³
HKLR	HY/2011/03	2020-04-20	AMS5	08:00	24-hr TSP	26	µg/m ³
HKLR	HY/2011/03	2020-04-23	AMS5	08:00	24-hr TSP	13	µg/m ³
HKLR	HY/2011/03	2020-04-28	AMS5	08:00	24-hr TSP	68	µg/m ³
HKLR	HY/2011/03	2020-04-06	AMS6	09:11	1-hr TSP	51	µg/m ³
HKLR	HY/2011/03	2020-04-06	AMS6	10:11	1-hr TSP	58	µg/m ³
HKLR	HY/2011/03	2020-04-06	AMS6	11:11	1-hr TSP	78	µg/m ³
HKLR	HY/2011/03	2020-04-09	AMS6	09:08	1-hr TSP	26	µg/m ³
HKLR	HY/2011/03	2020-04-09	AMS6	10:08	1-hr TSP	32	µg/m ³
HKLR	HY/2011/03	2020-04-09	AMS6	11:08	1-hr TSP	32	µg/m ³
HKLR	HY/2011/03	2020-04-15	AMS6	08:08	1-hr TSP	110	µg/m ³
HKLR	HY/2011/03	2020-04-15	AMS6	09:08	1-hr TSP	151	µg/m ³
HKLR	HY/2011/03	2020-04-15	AMS6	10:08	1-hr TSP	150	µg/m ³
HKLR	HY/2011/03	2020-04-21	AMS6	09:03	1-hr TSP	19	µg/m ³
HKLR	HY/2011/03	2020-04-21	AMS6	10:03	1-hr TSP	15	µg/m ³
HKLR	HY/2011/03	2020-04-21	AMS6	11:03	1-hr TSP	13	µg/m ³
HKLR	HY/2011/03	2020-04-24	AMS6	09:00	1-hr TSP	17	µg/m ³
HKLR	HY/2011/03	2020-04-24	AMS6	10:00	1-hr TSP	18	µg/m ³
HKLR	HY/2011/03	2020-04-24	AMS6	11:00	1-hr TSP	30	µg/m ³
HKLR	HY/2011/03	2020-04-29	AMS6	09:05	1-hr TSP	49	µg/m ³
HKLR	HY/2011/03	2020-04-29	AMS6	10:05	1-hr TSP	50	µg/m ³
HKLR	HY/2011/03	2020-04-29	AMS6	11:05	1-hr TSP	50	µg/m ³
HKLR	HY/2011/03	2020-04-03	AMS6	08:00	24-hr TSP	29	µg/m ³
HKLR	HY/2011/03	2020-04-08	AMS6	08:00	24-hr TSP	13	µg/m ³
HKLR	HY/2011/03	2020-04-14	AMS6	08:00	24-hr TSP	69	µg/m ³
HKLR	HY/2011/03	2020-04-20	AMS6	08:00	24-hr TSP	27	µg/m ³
HKLR	HY/2011/03	2020-04-23	AMS6	08:00	24-hr TSP	23	µg/m ³
HKLR	HY/2011/03	2020-04-28	AMS6	08:00	24-hr TSP	115	µg/m ³


Air Quality Monitoring Data

Project	Works	Date (yyyy-mm-dd)	Station	Time	Parameter	Results	Unit
HKLR	HY/2011/03	2020-05-05	AMS5	10:00	1-hr TSP	5	µg/m ³
HKLR	HY/2011/03	2020-05-05	AMS5	11:00	1-hr TSP	2	µg/m ³
HKLR	HY/2011/03	2020-05-05	AMS5	13:00	1-hr TSP	8	µg/m ³
HKLR	HY/2011/03	2020-05-11	AMS5	10:11	1-hr TSP	33	µg/m ³
HKLR	HY/2011/03	2020-05-11	AMS5	11:11	1-hr TSP	46	µg/m ³
HKLR	HY/2011/03	2020-05-11	AMS5	13:11	1-hr TSP	13	µg/m ³
HKLR	HY/2011/03	2020-05-15	AMS5	10:13	1-hr TSP	37	µg/m ³
HKLR	HY/2011/03	2020-05-15	AMS5	11:13	1-hr TSP	22	µg/m ³
HKLR	HY/2011/03	2020-05-15	AMS5	13:13	1-hr TSP	21	µg/m ³
HKLR	HY/2011/03	2020-05-21	AMS5	10:11	1-hr TSP	22	µg/m ³
HKLR	HY/2011/03	2020-05-21	AMS5	11:11	1-hr TSP	42	µg/m ³
HKLR	HY/2011/03	2020-05-21	AMS5	13:11	1-hr TSP	51	µg/m ³
HKLR	HY/2011/03	2020-05-27	AMS5	10:12	1-hr TSP	112	µg/m ³
HKLR	HY/2011/03	2020-05-27	AMS5	11:12	1-hr TSP	103	µg/m ³
HKLR	HY/2011/03	2020-05-27	AMS5	13:12	1-hr TSP	71	µg/m ³
HKLR	HY/2011/03	2020-05-04	AMS5	08:00	24-hr TSP	25	µg/m ³
HKLR	HY/2011/03	2020-05-08	AMS5	08:00	24-hr TSP	20	µg/m ³
HKLR	HY/2011/03	2020-05-14	AMS5	08:00	24-hr TSP	40	µg/m ³
HKLR	HY/2011/03	2020-05-20	AMS5	08:00	24-hr TSP	28	µg/m ³
HKLR	HY/2011/03	2020-05-27	AMS5	08:00	24-hr TSP	69	µg/m ³
HKLR	HY/2011/03	2020-05-05	AMS6	09:02	1-hr TSP	10	µg/m ³
HKLR	HY/2011/03	2020-05-05	AMS6	10:02	1-hr TSP	10	µg/m ³
HKLR	HY/2011/03	2020-05-05	AMS6	11:02	1-hr TSP	11	µg/m ³
HKLR	HY/2011/03	2020-05-11	AMS6	16:45	1-hr TSP	12	µg/m ³
HKLR	HY/2011/03	2020-05-11	AMS6	17:45	1-hr TSP	9	µg/m ³
HKLR	HY/2011/03	2020-05-11	AMS6	18:45	1-hr TSP	9	µg/m ³
HKLR	HY/2011/03	2020-05-15	AMS6	09:04	1-hr TSP	37	µg/m ³
HKLR	HY/2011/03	2020-05-15	AMS6	10:04	1-hr TSP	29	µg/m ³
HKLR	HY/2011/03	2020-05-15	AMS6	11:04	1-hr TSP	29	µg/m ³
HKLR	HY/2011/03	2020-05-21	AMS6	09:01	1-hr TSP	17	µg/m ³
HKLR	HY/2011/03	2020-05-21	AMS6	10:01	1-hr TSP	19	µg/m ³
HKLR	HY/2011/03	2020-05-21	AMS6	11:01	1-hr TSP	29	µg/m ³
HKLR	HY/2011/03	2020-05-27	AMS6	09:01	1-hr TSP	58	µg/m ³
HKLR	HY/2011/03	2020-05-27	AMS6	10:01	1-hr TSP	63	µg/m ³
HKLR	HY/2011/03	2020-05-27	AMS6	11:01	1-hr TSP	82	µg/m ³
HKLR	HY/2011/03	2020-05-04	AMS6	08:00	24-hr TSP	28	µg/m ³
HKLR	HY/2011/03	2020-05-08	AMS6	08:00	24-hr TSP	16	µg/m ³
HKLR	HY/2011/03	2020-05-14	AMS6	08:00	24-hr TSP	44	µg/m ³
HKLR	HY/2011/03	2020-05-20	AMS6	08:00	24-hr TSP	31	µg/m ³
HKLR	HY/2011/03	2020-05-26	AMS6	08:00	24-hr TSP	38	µg/m ³

Remark:

1) Due to power failure, 24-hr TSP monitoring on 26 May 2020 at AMS5 (Ma Wan Chung Village) was rescheduled to 27 May 2020.


Graphical Plot of 1-hour TSP at AMS5 and AMS6

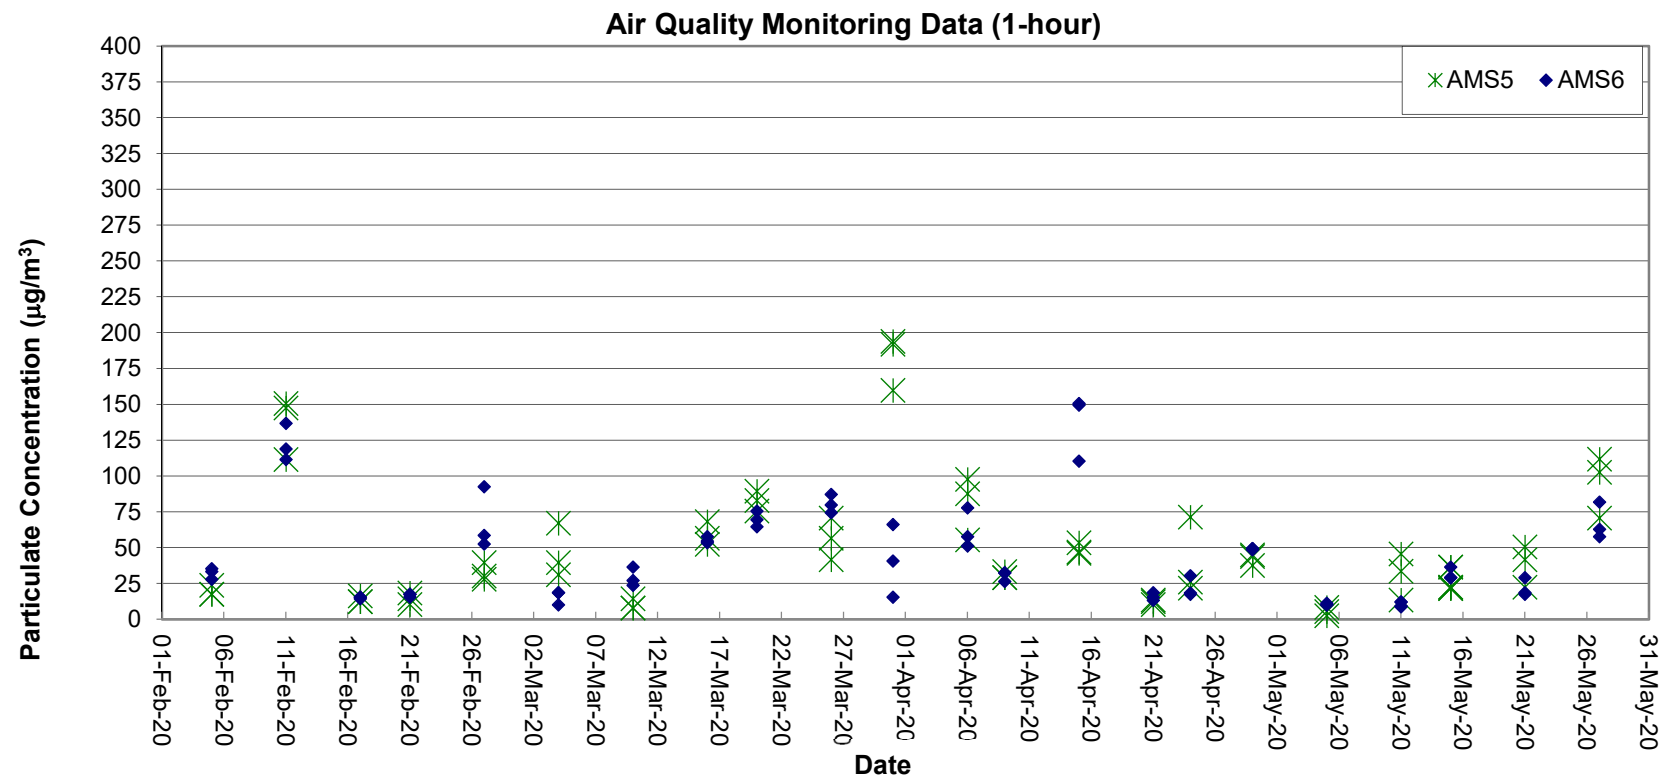

Remark:
1) There were no works for Contract No. HY/2011/03 between 25 January 2020 and 2 February 2020. As such, 1-hr TSP monitoring (which was scheduled on 30 January 2020) for stations AMS 5 and AMS 6 were suspended.

Graphical Plot of 24-hour TSP at AMS5 and AMS6

Air Quality Monitoring Data (24-hour)

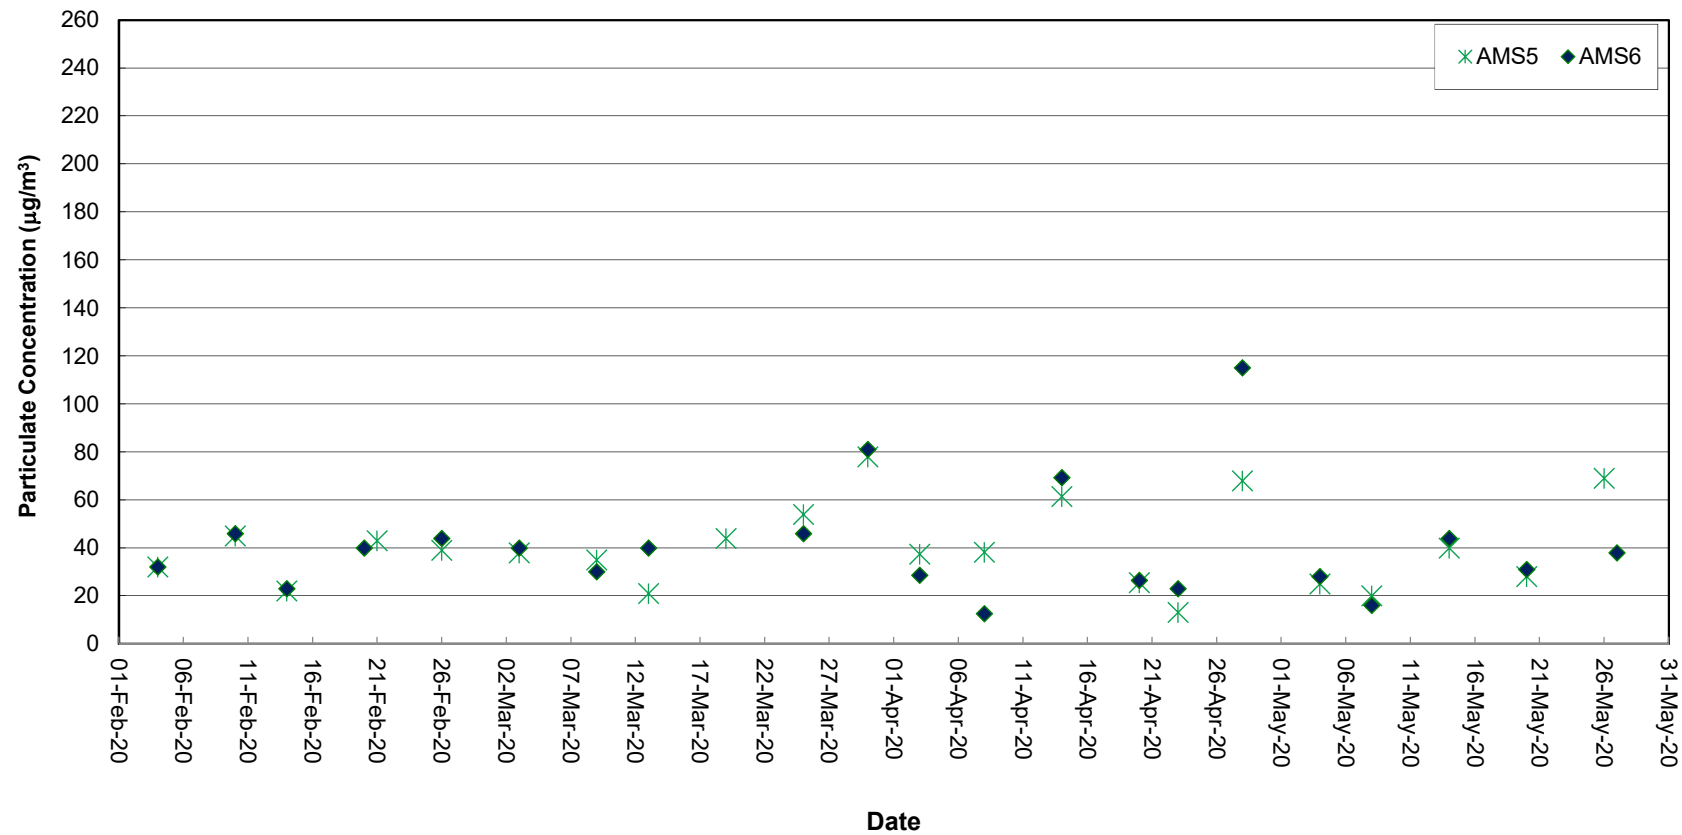

Remarks:

- 1) There were no works for Contract No. HY/2011/03 between 25 January 2020 and 2 February 2020. As such, 24-hr TSP monitoring (which was scheduled on 29 January 2020) for stations AMS 5 and AMS 6 were suspended.
- 2) Due to power failure, 24-hr TSP monitoring on 20 February 2020 at AMS5 (Ma Wan Chung Village) was rescheduled to 21 Feb 2020.
- 3) Due to power failure and malfunction of High Volume Sampler (HVS) at AMS6 - Dragonair / CNAC (Group) Building (HKIA), 24-hr TSP monitoring on 19 March 2020 at AMS6 was cancelled. The HVS was repaired on 25 March 2020. The 24-hr TSP monitoring at AMS6 was resumed on 25 March 2020.
- 4) Due to power failure, 24-hr TSP monitoring on 26 May 2020 at AMS5 (Ma Wan Chung Village) was rescheduled to 27 May 2020.